





**ECAT-2610** 

EtherCAT Slave to Modbus RTU Master Gateway

# **A** Features Powerful MCU handles efficient network traffic ■ 2 x RJ-45 EtherCAT Connectors ■ Integrate RS-232/422/485 serial device to EtherCAT ■ Allows system integrators to retro-fit older automation devices into modern EtherCAT communication structures Requires no hardware or software changes to be made to the connected device Compatible with all PLCs with EtherCAT support Performs complete serial protocol conversion, no PLC function blocks required Supports maximum 256 WORD Input and 256 WORD Output Data Supports Serial Port interface ☐ Supports Modbus RTU (Master) Protocol ☐ Supports RS-232/422/485 Port ☐ Supports Maximum Baud Rate 115200 bps

### **■** Introduction

Integrate your serial RS-232/422/485 based industrial devices and equipment to an EtherCAT control system without the need for any changes to the device. Just connect, configure and it's finished.

The ECAT-2610 Communicator is a proven and trusted protocol converter gateway that connects non-networked industrial devices and equipment to EtherCAT. The gateway performs an intelligent protocol conversion and presents the serial data to the Master PLC/Controller as easily processed I/O data.

\* EtherCAT® is registered trademark and patented technology, licensed by Beckhoff Automation GmbH, Germany.

### Specifications


COM Ports				
Ports	1 x RS-232/422/485			
Protocol	Modbus RTU (Master)			
EtherCAT				
Ports	RJ-45 x 2 Distance between Stations: Max. 100 m (100BASE-TX) Data Transfer Medium: Ethernet/EtherCAT Cable (Min. CAT 5e)			
Cycle Time	10 ms			
Distributed Clocks	N/A			
Power				
Reverse Polarity Protection	Yes			
Input Range	+12 VDC ~ +48 VDC			
Consumption	0.1 A @ 24 VDC			
Mechanical				
Dimensions (W x L x H)	33 mm x 127 mm x 99 mm			
Installation	DIN-Rail			
Casing	Plastic			
Environmental				
Operating Temperature	-25 ~ +75 °C			
Storage Temperature	-30 ∼ +80 °C			
Humidity	10 ~ 90% RH, Non-condensing			

ICP DAS CO., LTD Website: http://www.icpdas.com Vol. 2020.9 1/2


## **■ Pin Assignments**

#### COM1 (Console Port) Pin Pin Assign-Assign-Terminal No. ment ment 01 RxD 02 07 03 TxD 08 04 09 GND 05


COM2/COM3 (Modbus RTU)			
Terminal No.		Pin Assignment	
	COM2	TxD+/D+	
		TxD-/D-	
		RxD+	
		RxD-	
	COM3	N/A	
		ISO.GND	
		TxD	
		RxD	



### Applications

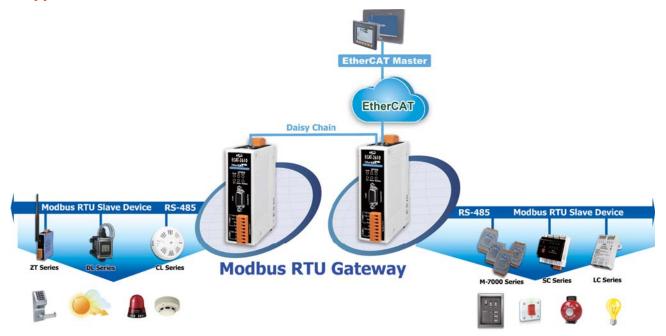

### **■** Dimensions (Units: mm)

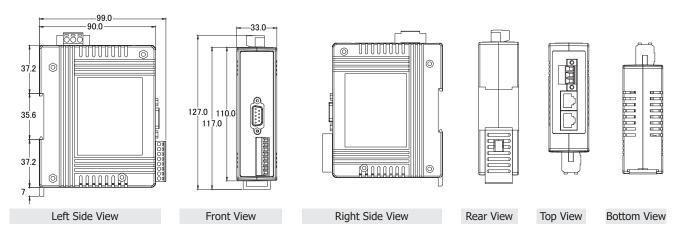

### **■** Ordering Information

EtherCAT Save to Modbus RTU Master Gateway (RoHS)
Includes CA-0915 (DB9 Male to DB9 Female Cable, 1.5 M)

ICP DAS CO., LTD Website: http://www.icpdas.com Vol. 2020.9 2/2